

WATER REQUIREMENT

WATER REQUIREMENT AT
FIELD ELEVATION
-WITHIN 30m OF FIELD
-DOWNSTREAM OF BACKFLOW
IS 363 l/min @ 5.96 Bars

IRRIGATION LEGEND

PRODUCT DESCRIPTION

- HUNTER I-40-04-SS-ON-B-XX/I-40-06-SS-ON-B-XX, NOZZLE AS SHOWN
- HUNTER I-40-04-SS-B-XX/I-40-06-SS-B-XX, NOZZLE AS SHOWN
- HUNTER I-40-04-SS-HS-B-15/I-40-06-SS-HS-B-15, NOZZLE AS SHOWN


NOZZLE PERFORMANCE:

- #8 @ 5.0 Bars - 38.2 l/min 14.3m RADIUS
- #10 @ 5.5 Bars - 49.3 l/min 15.8m RADIUS
- #13 @ 5.5 Bars - 53.9 l/min 16.2m RADIUS
- #15 @ 5.5 Bars - 68.9 l/min 18.0m RADIUS
- #23 @ 5.5 Bars - 92.7 l/min 19.8m RADIUS
- #23ON @ 5.5 Bars - 90.8 l/min 20.4m RADIUS

- ⊕ HUNTER ICV/IBV ELECTRIC CONTROL VALVE SIZE AS SHOWN
- ⊕ HUNTER HQ-44-XX-AW QUICK COUPLER VALVE (OPTIONAL)
- ⊕ HUNTER ACC-1800-04M SOLID STATE METAL CABINET CONTROLLER
- ⊕ HUNTER SOLAR-SYNC-SEN ON SITE WEATHER SENSOR
- ⊕ WATER METER MINIMUM SIZE @ 363 l/min IS 63mm
- ⊕ BACKFLOW PREVENTER SIZED TO SYSTEM l/min
- MAINLINE PIPE
- LATERAL PIPE
- ==== SLEEVEING
- ⊗ ISOLATION VALVE LINE SIZED
- ⊕ HUNTER FLOW SENSOR IN LINE SIZED FLOW CLIK TEE "FCT"

IRRIGATION NOTES

1. SPRINKLER LOCATIONS ARE TO SCALE
2. PIPE LOCATIONS ARE DIAGRAMMATIC
3. ALL SPRINKLERS TO BE INSTALLED ON 32mm SCH 80 SWING JOINTS
4. ALL COMPONENTS TO BE INSTALLED AS PER MANUFACTURERS RECOMMENDATIONS
5. MAINLINE DEPTH TO BE NO LESS THAN 460mm
6. LATERAL DEPTH TO BE NO LESS THAN 100mm
7. ELECTRIC CONTROL VALVES TO BE COVERED WITH 12" VALVE BOX
8. LOCATE VALVES/OCV'S OUT OF HIGH TRAFFIC AREAS
9. WIRE SPLICE CONNECTIONS TO BE WATERPROOF
10. OCV TO BE LOCATED IN 10" VALVE BOX
11. ALL SLEEVES TO BE 2X PIPE RUN THROUGH THEM
12. INSTALL ALL COMPONENTS AS PER LOCAL, STATE, FEDERAL CODES
13. REFER TO HUNTER INSTALLATION DETAILS
14. REFER TO HUNTER CATALOG FOR PERFORMANCE SPECIFICATIONS
15. ADD HUNTER "FS" FOR DIRTY WATER VALVE
16. ADD HUNTER "AS" FOR PRESSURE REGULATED VALVE

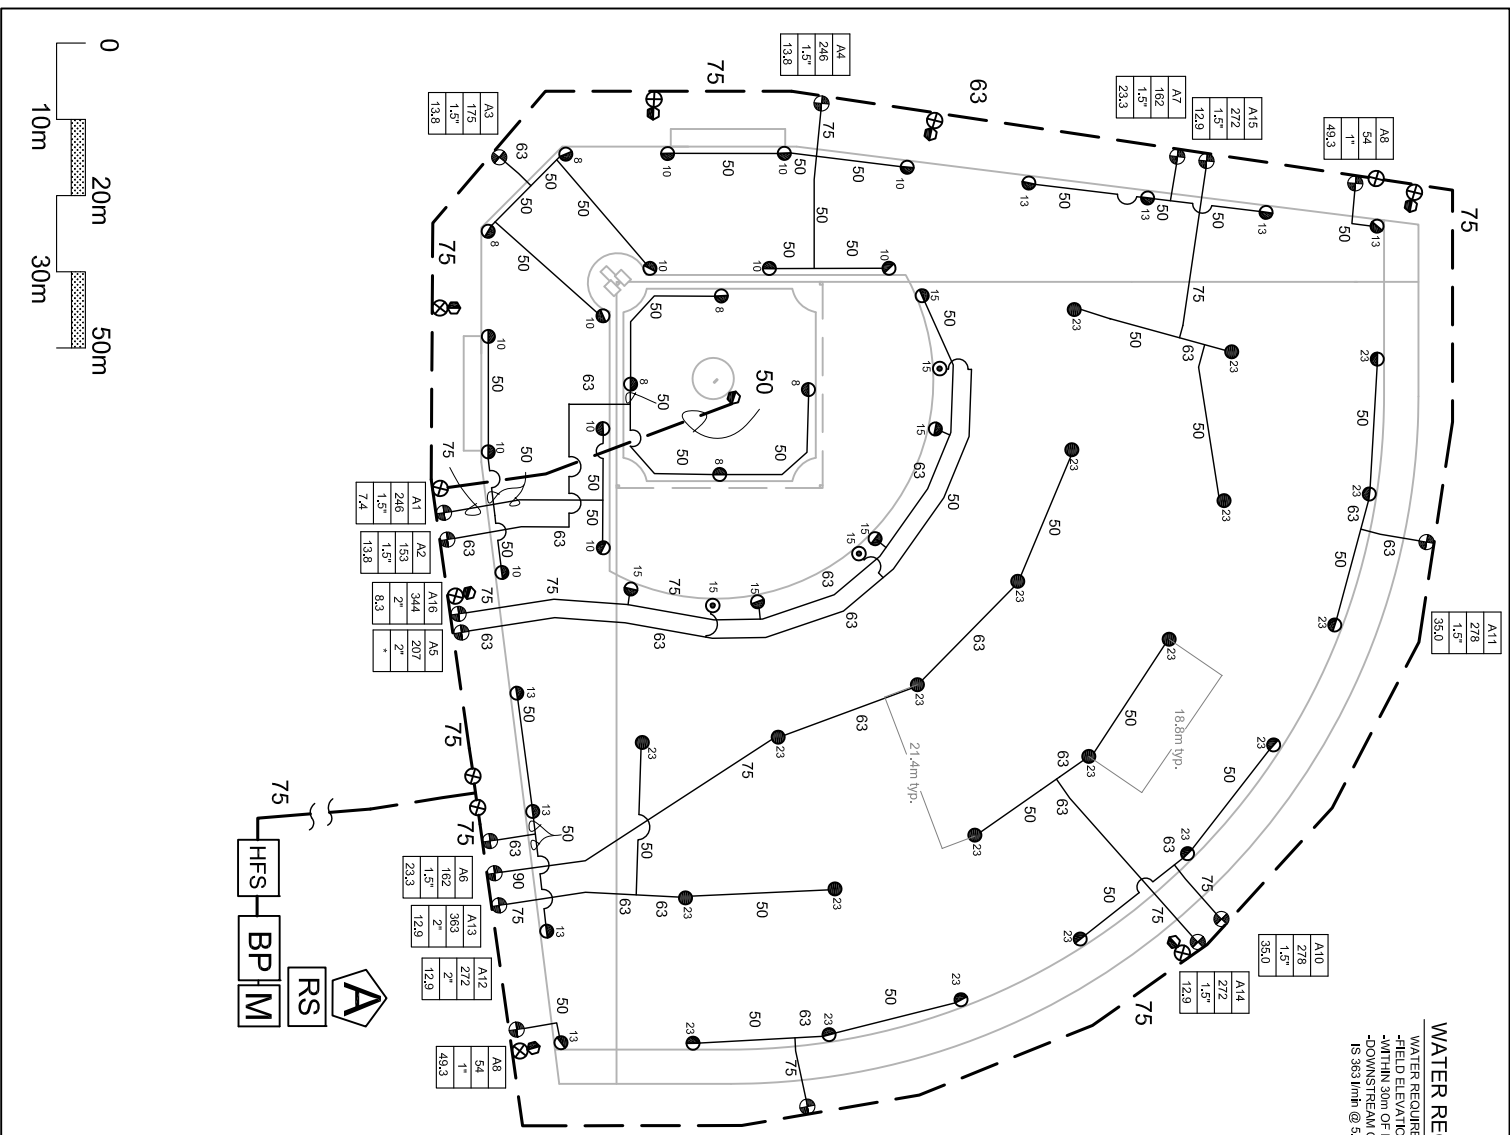

VALVE ID GUIDE

A1	STATION NUMBER
273	1.5"
19	PRECIPITATION RATE mm/hr

SYSTEM PERFORMANCE DATA

ZONE	SIZE	FLOW l/min	PR m	DU min	SC ₁₀₀ m ² /min
A1	1.5"	14.7	2.96	7.4	1.3
A2	1.5"	9.2	1.53	8.6	1.2
A3	1.5"	10.5	1.75	13.8	1.3
A4	1.5"	14.7	2.46	13.8	1.2
A5	2"	12.4	2.07	*	*
A6	1.5"	9.7	1.62	23.3	1.1
A7	1.5"	9.7	1.62	23.3	1.1
A8	2-1"	6.5	1.08	49.3	1.3
A9	1.5"	16.6	2.78	35.0	1.3
A10	1.5"	16.6	2.78	35.0	1.3
A11	1.5"	16.6	2.78	35.0	1.3
A12	1.5"	16.3	2.72	12.9	1.3
A13	2"	21.8	3.63	12.9	1.3
A14	1.5"	16.3	2.72	12.9	1.3
A15	1.5"	16.3	2.72	12.9	1.3
A16	1.5"	19.9	3.31	8.3	1.2

OFFICIAL BASEBALL FIELD

I-40 FOUR ROW DESIGN
LOOPED MAINLINE



Hunter Industries
1940 Diamond Street
San Marcos, California 92078
SpecPro Technical Assistance
1-800-319-4796
www.HunterIndustries.com

SHEET

1 OF 1

Hunter Industries offers this plan as a general guide for estimating purposes and offers no indemnity, warranty or performance guarantee. The user assumes all responsibility for the accuracy of every system and of every site we recommend that a qualified irrigation designer be consulted.